


CERTIFICATE

Certified Passive House Component

Component-ID 0611wi03 valid until 31st December 2020

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

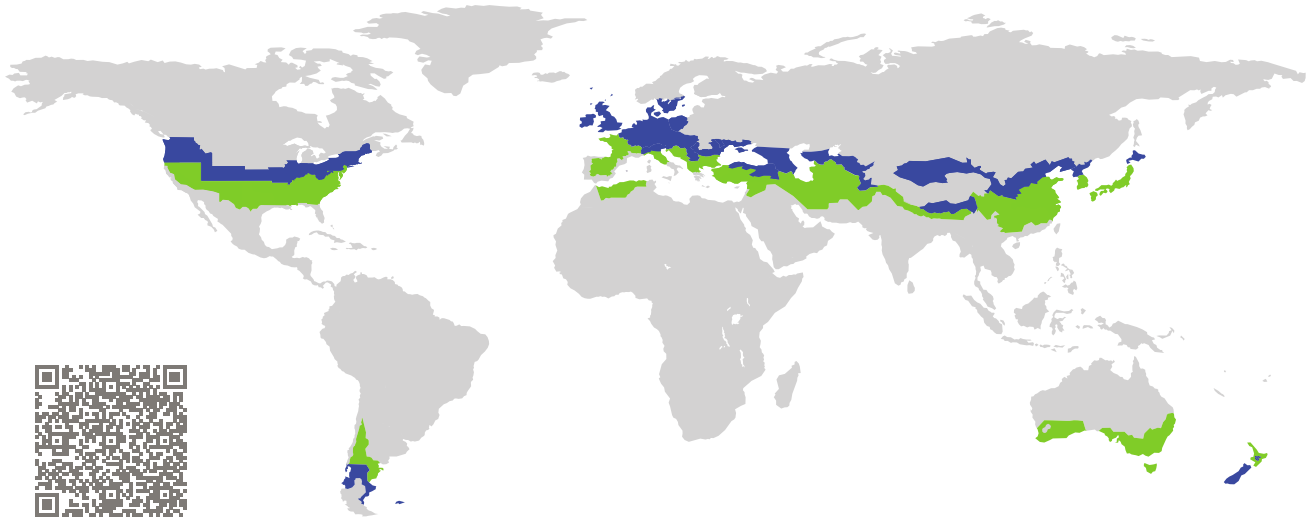


Category: **Window Frame**
Manufacturer: **Viking Window AS,
Järvamaa,
Estonia**
Product name: **Viking SW 14 Aluclad Passive**

**This certificate was awarded based on the following
criteria for the cool, temperate climate zone**

Comfort $U_W = 0.80 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$

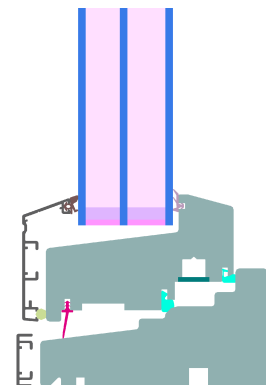

Passive House
efficiency class

phE

phD

phC

phB

phA


www.passivehouse.com

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

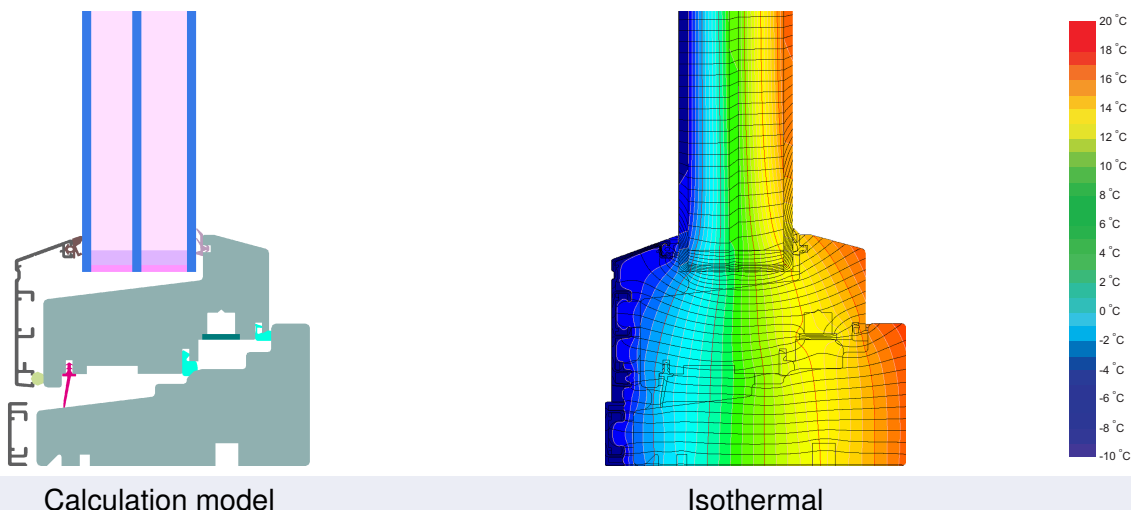

Calculation model

Isothermal

Description

Timberframe (0.11 W/(mK)) with aluminium facing shell. Pane thickness: 50 mm (4/18/4/20/4), Re-bate depth: 16 mm.

Explanation





The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 0.70$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.54	W/(m ² K)
		↓	↓	↓	↓	
Window	$U_W =$	0.80	0.76	0.71	0.68	W/(m ² K)


Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.


The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values			Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -panel edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top	(to)		102	0.86	0.022	0.72
Side	(s)		102	0.86	0.022	0.72
Bottom	(bo)		102	0.83	0.023	0.72
Mullion 1 casement	(m1)		190	0.86	0.022	0.72
Spacer: SWISSPACER Ultimate			Secondary seal: Polysulfid			

Validated installations

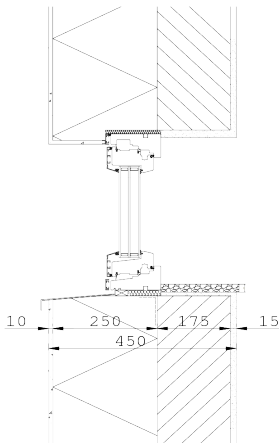EIFS	
	
$\Psi_{install}$	W/(m K)
Top	0.010
Side	0.010
Bottom	0.021
$U_{W,installed} = 0.84 \text{ W/(m}^2 \text{ K)}$	

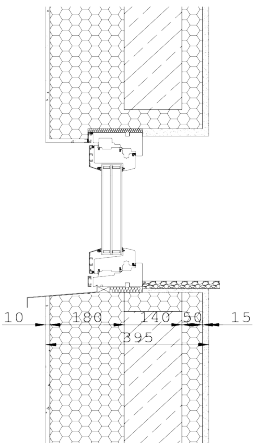Insulated formwork blocks	
	
$\Psi_{install}$	W/(m K)
Top	0.009
Side	0.009
Bottom	0.020
$U_{W,installed} = 0.83 \text{ W/(m}^2 \text{ K)}$	

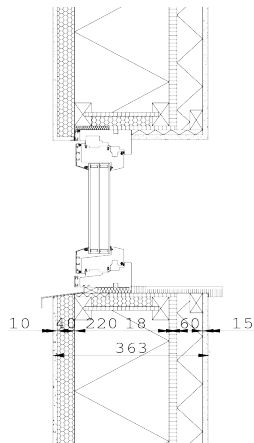Timber frame	
	
$\Psi_{install}$	W/(m K)
Top	0.016
Side	0.016
Bottom	0.022
$U_{W,installed} = 0.85 \text{ W/(m}^2 \text{ K)}$	

